



2/27/2020 4:38:35 PM BIM 360://00020012 - PPL 3700 Alabama Apartments3700 Alabama PPL_Apts - Elec - R20.rvt

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Light Spill at Property Line	+	0.1 fc	0.5 fc	0.0 fc	N/A	N/A
North Entrance	+	5.5 fc	9.1 fc	1.7 fc	5.4:1	3.2:1
South Court Yard	+	2.2 fc	9.2 fc	0.6 fc	15.3:1	3.7:1
South Parking Area	+	1.7 fc	3.6 fc	0.5 fc	7.2:1	3.4:1

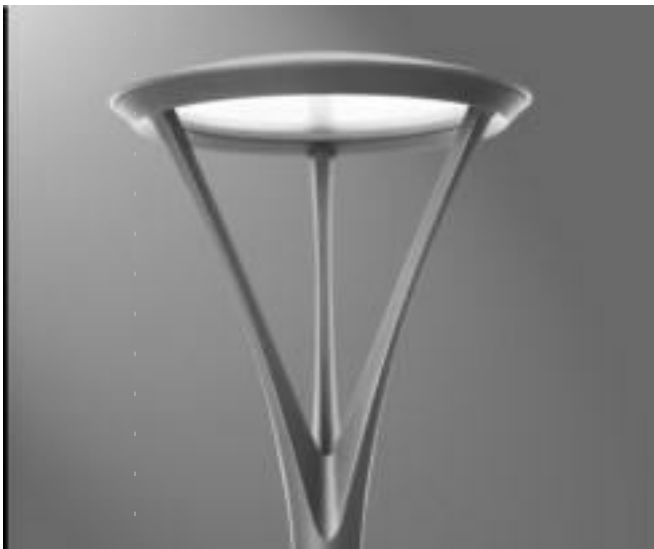

TYPE A & B
LED POST TOP AREA LIGHT
FIXTURE HEIGHT 12, 14'
TYPE S DISTRIBUTION
PROVIDED WITH INTEGRAL PHOTOCELL AND MOTION CONTROL SENSOR.

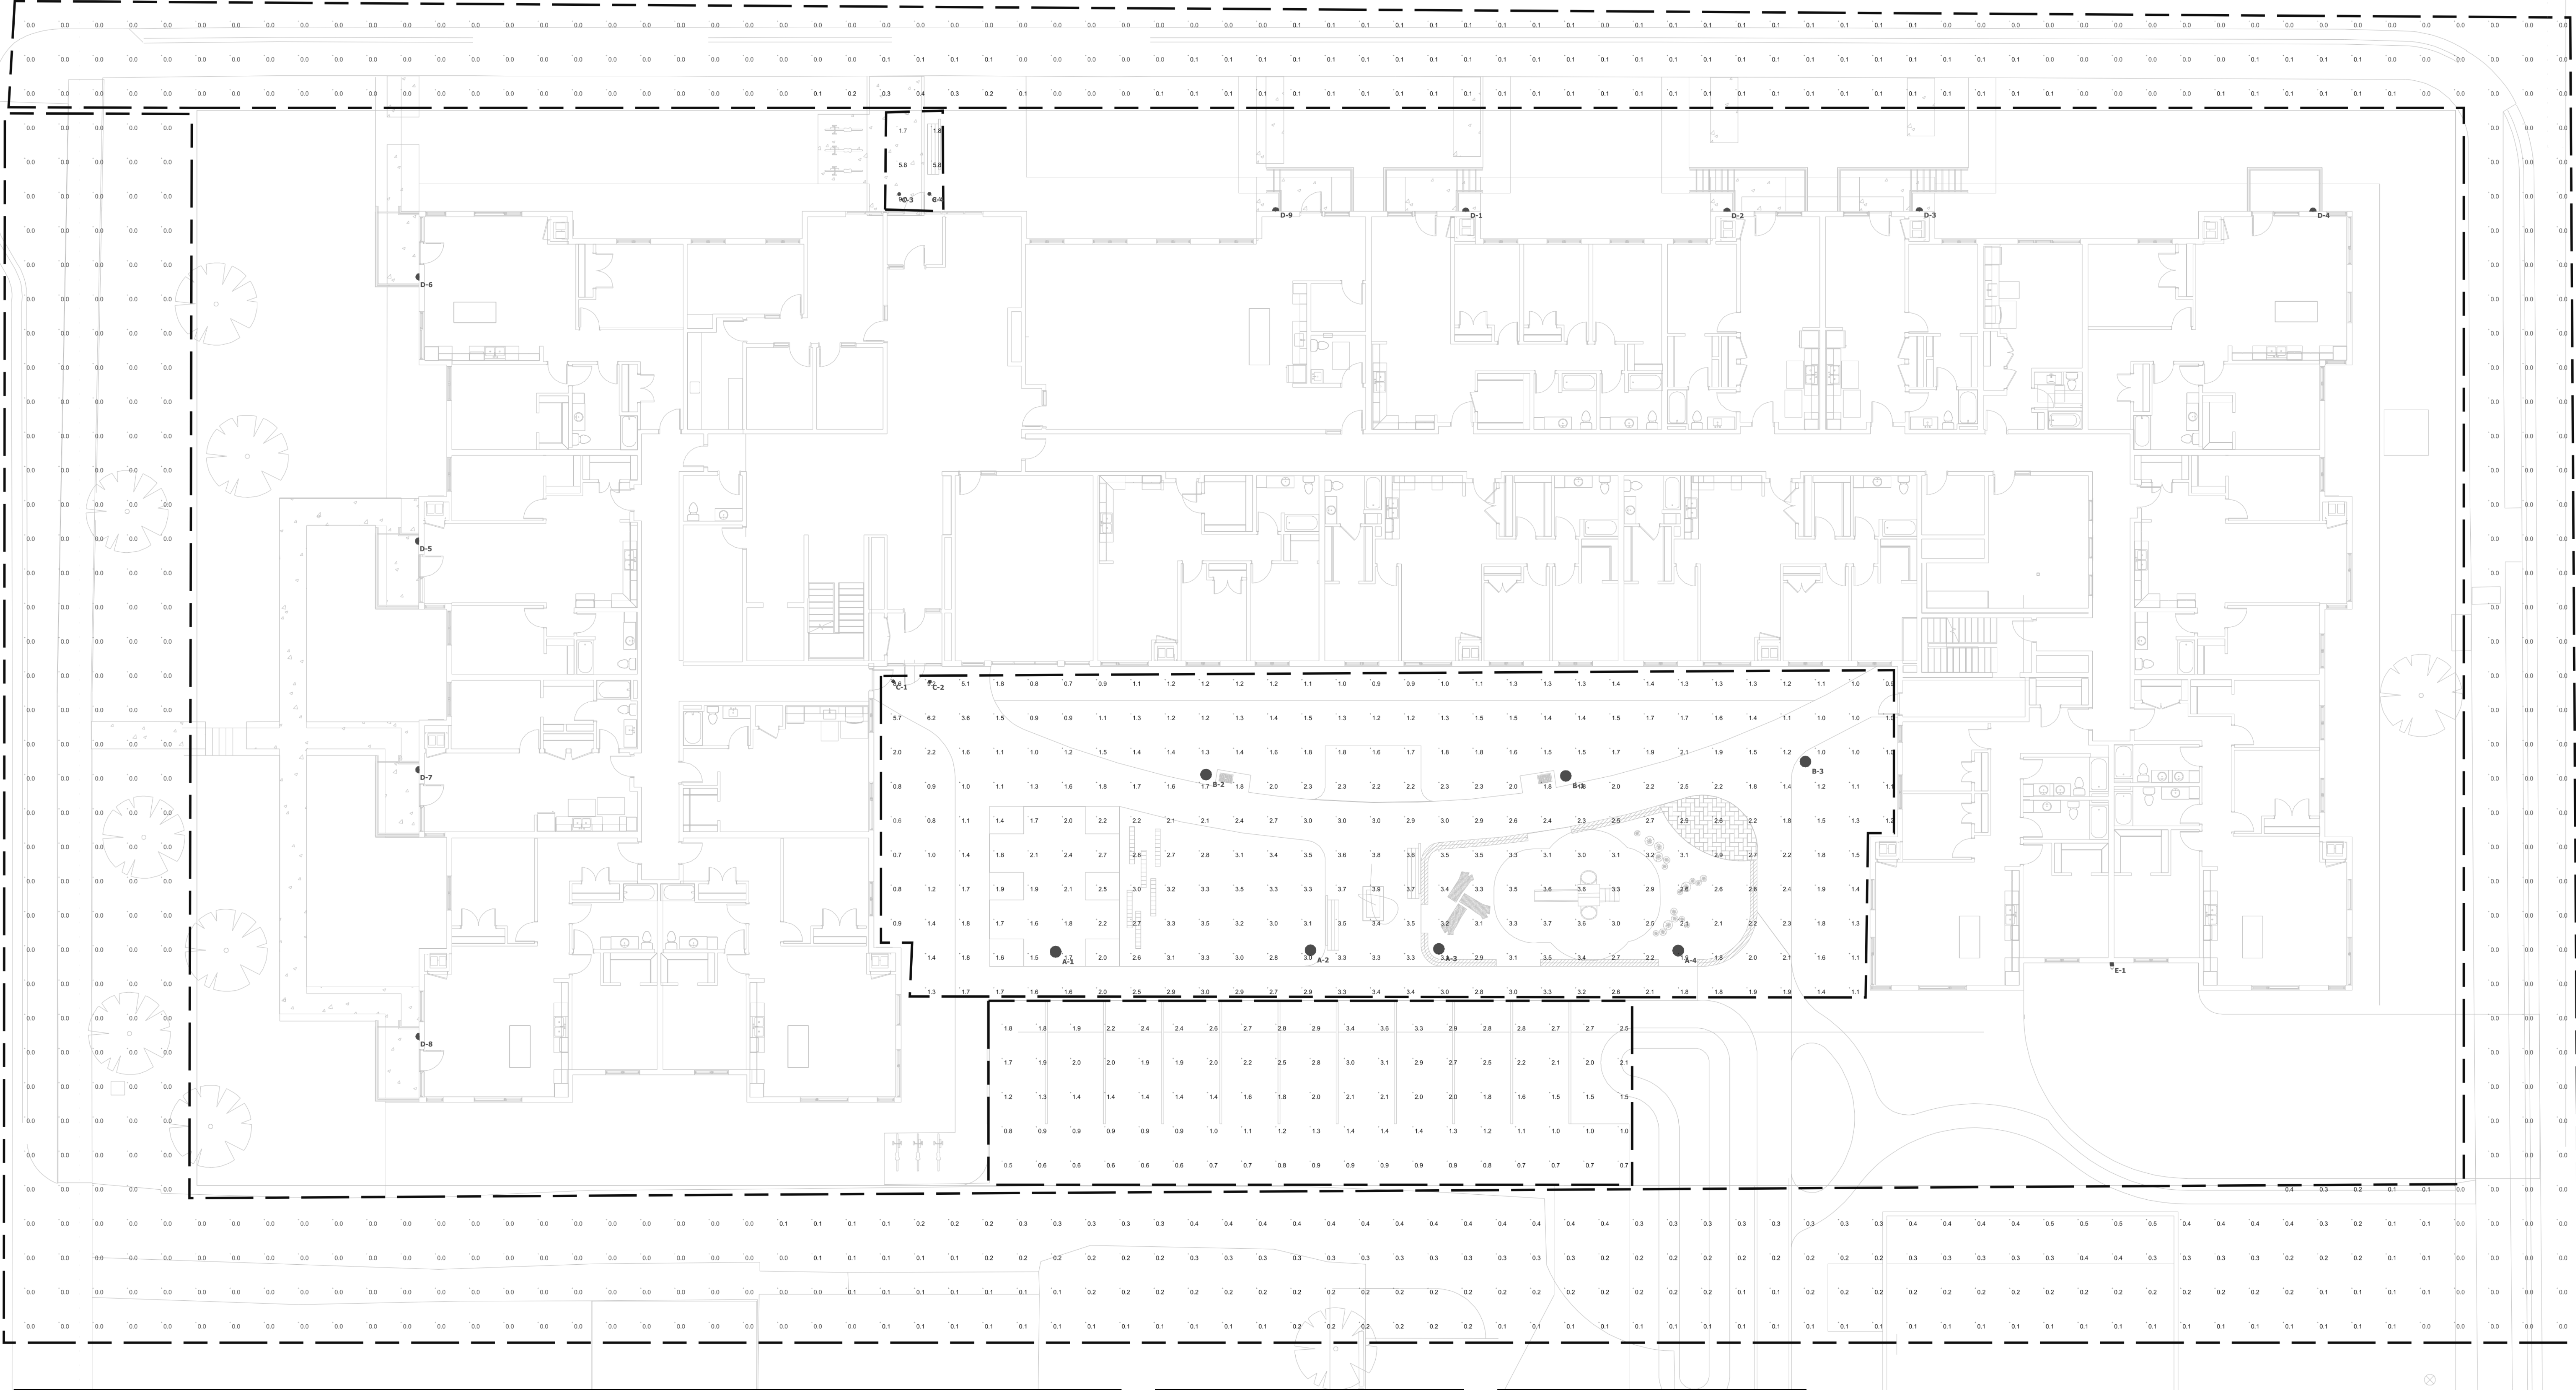

TYPE D
LED PATIO WALL SCONCE
PROVIDED WITH DAYLIGHT SENSOR



TYPE C
LED RECESSED CAN LIGHT IN CANOPY
PROVIDED WITH DAYLIGHT SENSOR CONTROL



TYPE D
LED WALL PACK
PROVIDED WITH INTEGRAL DAYLIGHT SENSOR CONTROL AND MOTION CONTROL SENSOR

LIGHTING CONTROL SUMMARY:

PARKING AND COURTYARD AREAS:
POLE MOUNTED LIGHTS WILL BE PROVIDED WITH INTEGRAL PHOTOCELL AND MOTION SENSORS. LUMINAIRES WILL TURN ON WHEN DAYLIGHT LEVELS DECREASE TO DAYLIGHT SENSOR SETPOINT. WHEN MOTION IS DETECTED LUMINAIRE WILL BE AT 100% OUTPUT. WHEN NO MOTION IS DETECTED FOR PRESET TIME DELAY, LIGHT LEVEL WILL DECREASE TO ABOUT 50%.

GARAGE ENTRANCE LED WALL PACK:
LIGHT WILL BE PROVIDED WITH INTEGRAL PHOTOCELL AND MOTION SENSORS. LUMINAIRES WILL TURN ON WHEN DAYLIGHT LEVELS DECREASE TO DAYLIGHT SENSOR SETPOINT. WHEN MOTION IS DETECTED LUMINAIRE WILL BE AT 100% OUTPUT. WHEN NO MOTION IS DETECTED FOR PRESET TIME DELAY, LIGHT LEVEL WILL DECREASE TO ABOUT 50%.

PATIO LIGHTS:
LIGHTS WILL BE PROVIDED WITH INTEGRAL DAYLIGHT SENSOR. RESIDENT MAY USE SWITCH INSIDE UNIT TO TURN POWER ON/OFF TO LIGHT. LIGHT WILL ONLY TURN ON WHEN DAYLIGHT LEVELS FALL BELOW TEN DAYLIGHT SENSOR SETTING.

CANOPY LIGHTS:
LIGHTS WILL BE ON AT 100% FROM DUSK TO DAWN.

POST TOP AREA LIGHT DETAIL

