
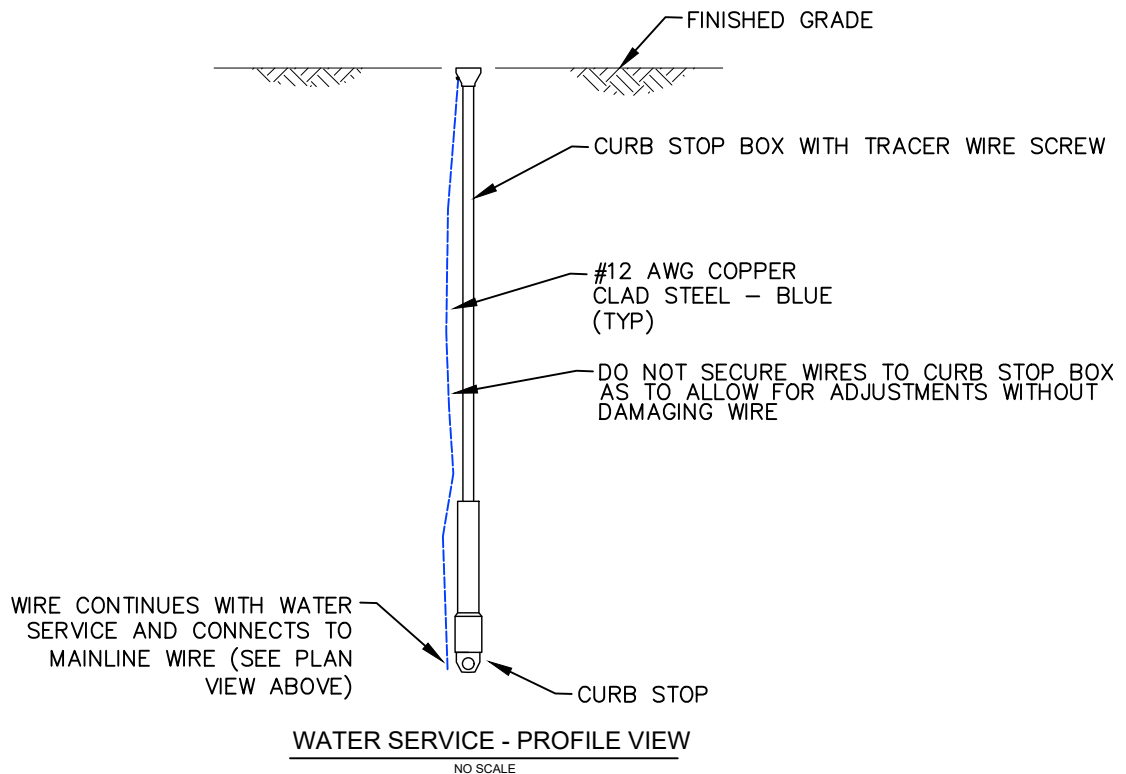


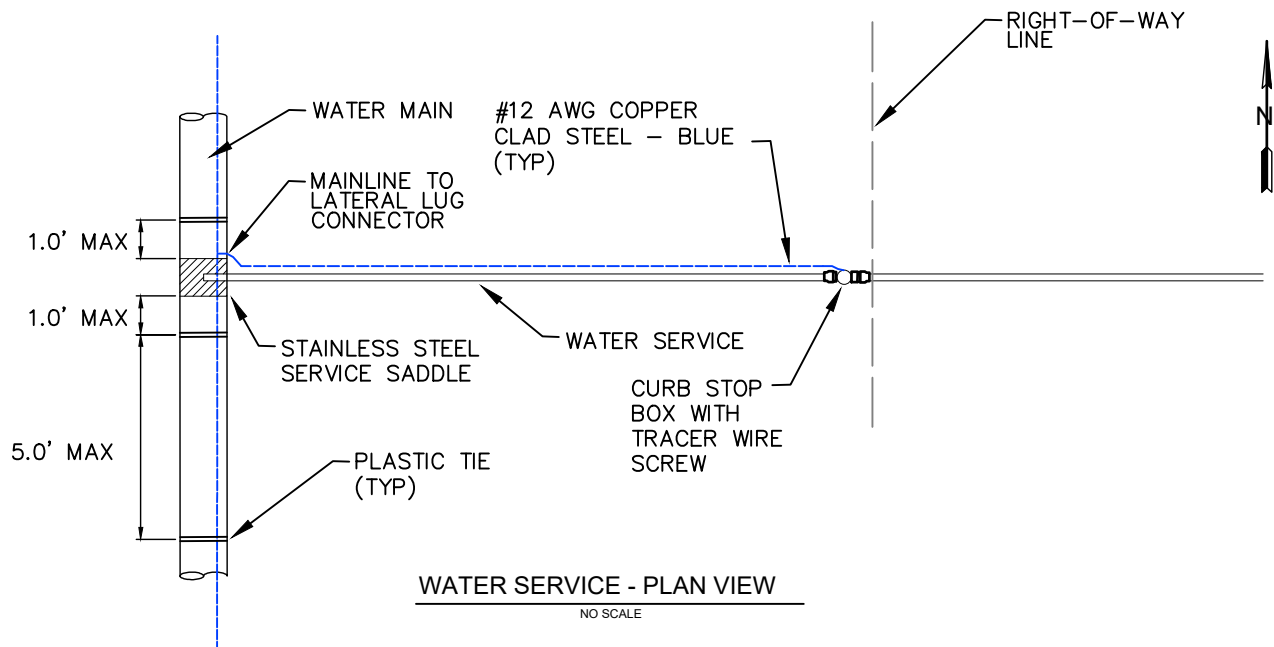

NOTES:

1. WIRE SHALL BE INSTALLED IMMEDIATELY ADJACENT TO THE SERVICE PIPE.
2. THE WIRE SHALL BE FASTENED TO THE PIPE WITH PLASTIC TIES AT 5' MAXIMUM SPACING AND WITHIN 1' MAXIMUM OF THE STAINLESS STEEL WATER SERVICE SADDLE.
3. ALL SERVICE LINE AND MAINLINE TRACER WIRE MUST BE TESTED TO ENSURE THAT IT IS TRACEABLE AFTER WATER MAIN IS INSTALLED AND BEFORE THE ROAD CONSTRUCTION BEGINS.
4. IF THE WATER MAIN OR SERVICES ARE PLASTIC, THE CONTRACTOR MUST INSTALL TRACER WIRE FOR THE ENTIRE WATER SYSTEM SO THAT EACH SERVICE AND MAIN CAN BE ELECTRONICALLY LOCATED.