


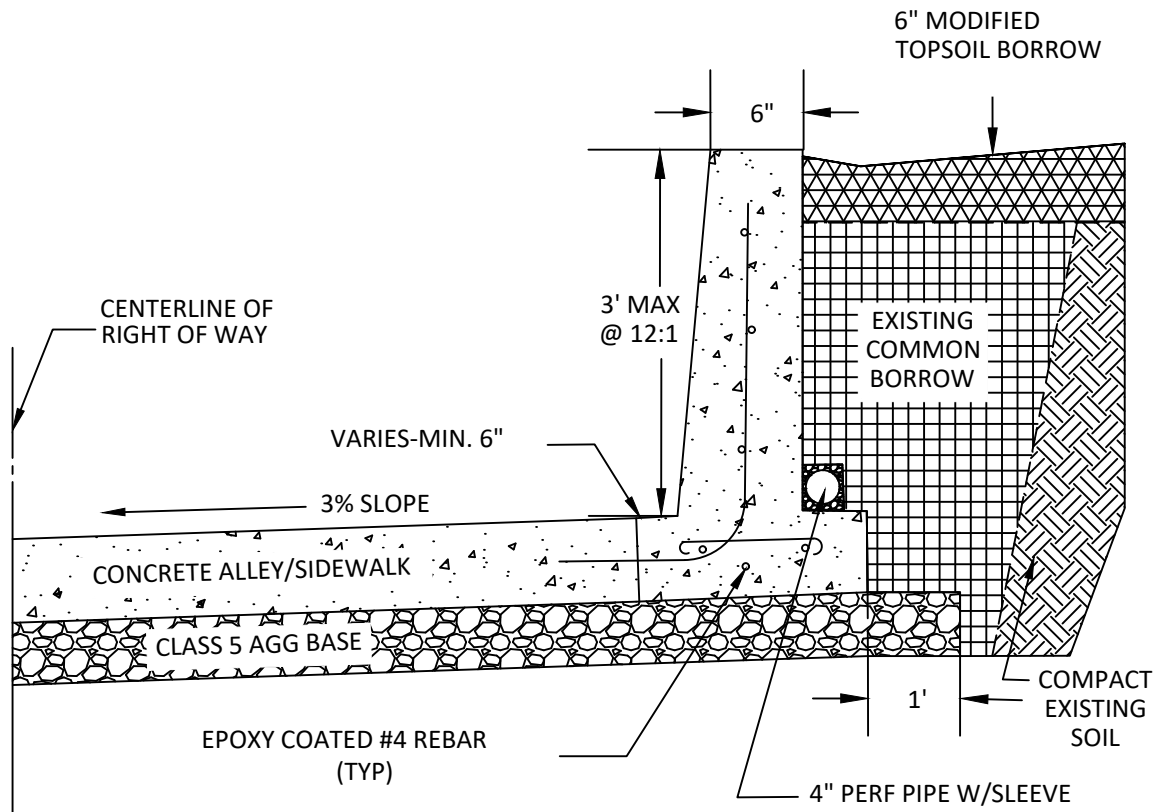

NOTES:

1. EXTEND ALLEY GRADE A MINIMUM OF 6" BEYOND EDGE OF ALLEY BEFORE WALL.
2. VERTICAL CURB TO BE 6" AT TOP OF CURB.
3. FACE OF VERTICAL CURB TO TO HAVE A 12:1 SLOPE.
4. VERTICAL CURB TO BE PAID PER LINEAR FOOT.
5. EPOXY COATED #4 REBAR IS INCIDENTAL.
6. 4" PERFORATED PIPE W/SLEEVE IS INCIDENTAL.
7. CONCRETE TO BE MNDOT 3F52 MIX DESIGN WITH TARGET 6.5% + 2% -1.5% AIR CONTENT.
8. MEMBRANE CURING COMPOUND SHALL BE CLEAR TK2519 DCWB, AMS 3754 CLEAR OR APPROVED EQUAL.